

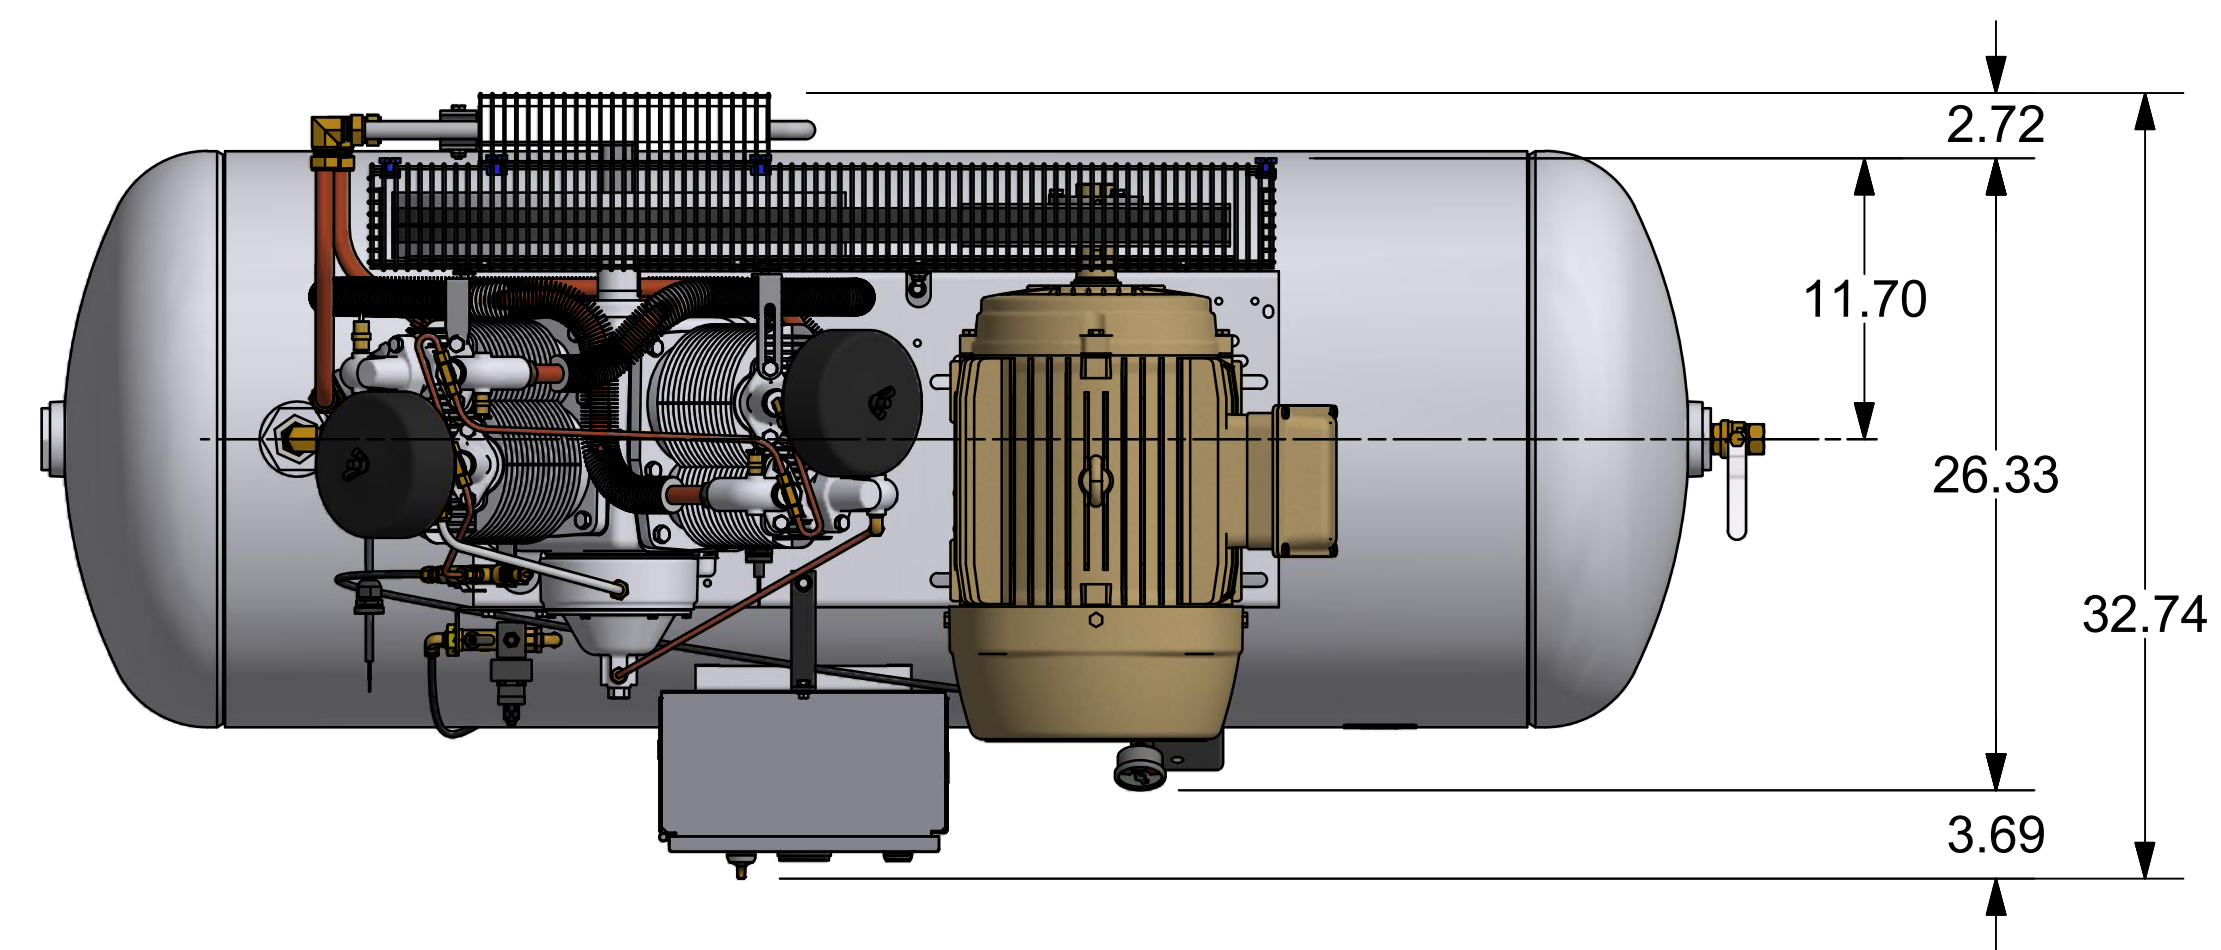



REVISION HISTORY						
ZONE	REV	DESCRIPTION	ECN #	DATE	DWN	CHK
	02	REVISED AS PER ECN, UPDATED OLD RECEIVER FOOT WITH SADDLE FOOT	1133227	14-Apr-20	sxd0419	kwt0829

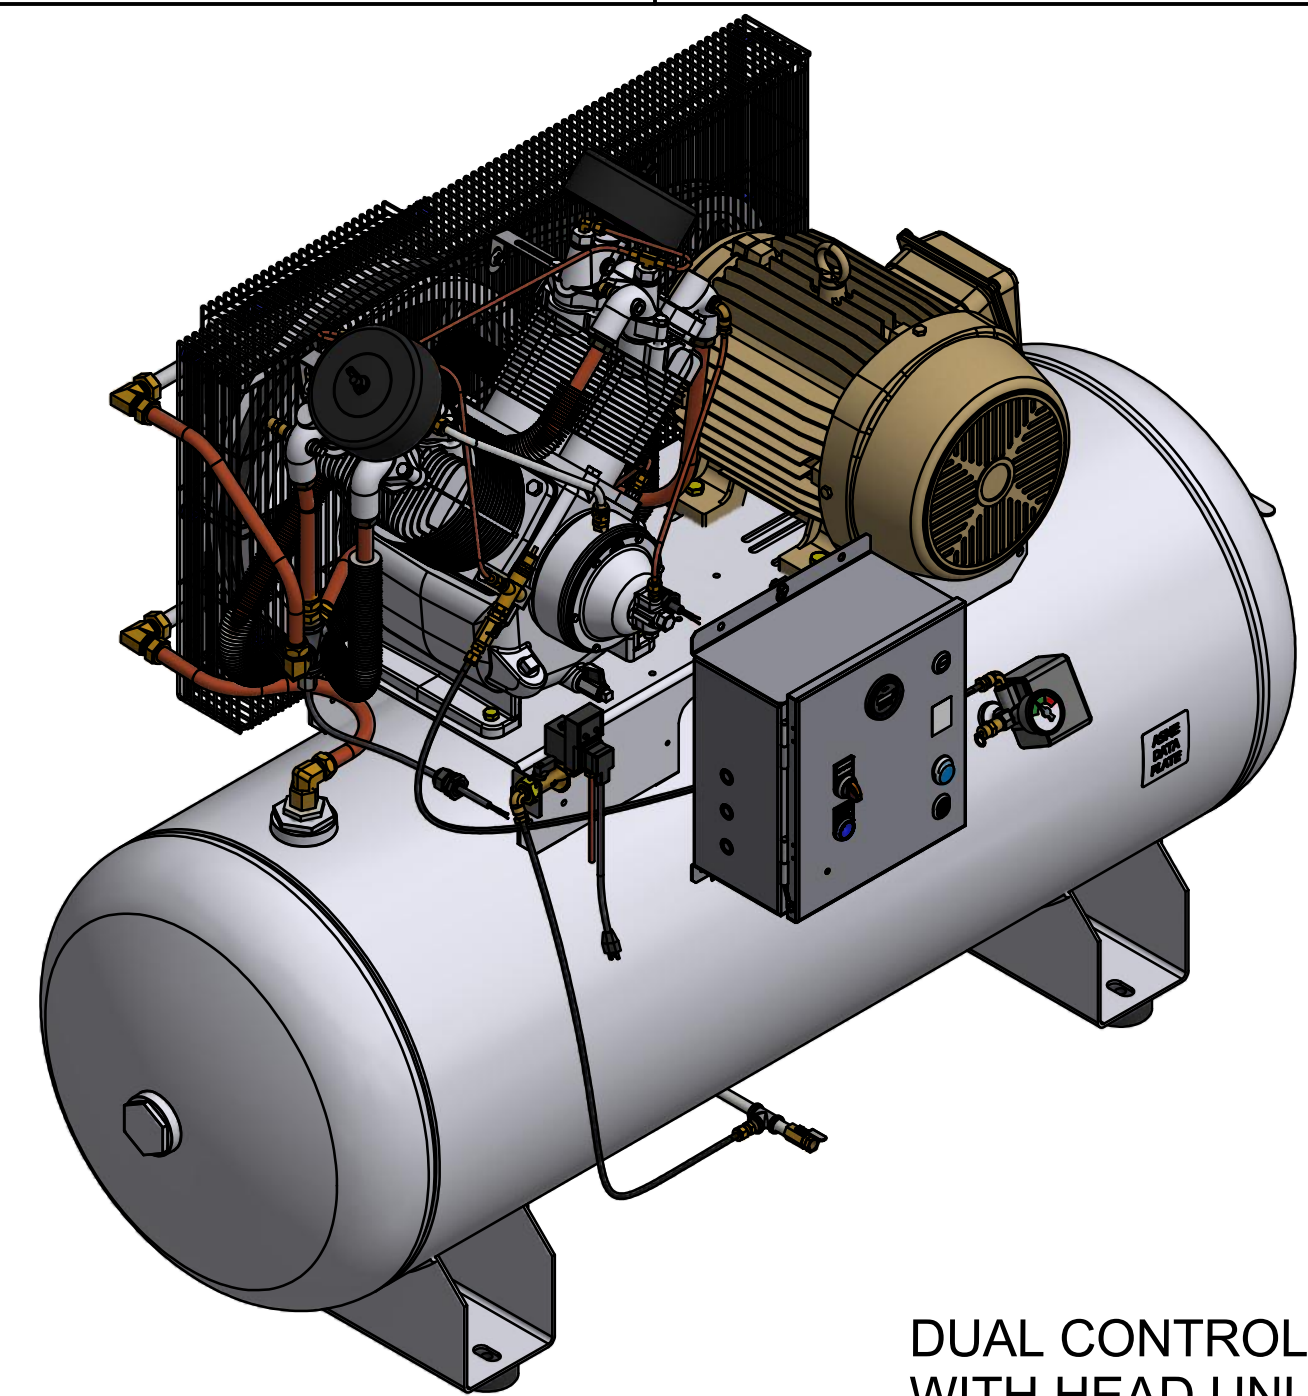


- DUAL CONTROL PILOT VALVE WITH HEAD UNLOADERS (OPTIONAL)
- HIGH TEMPERATURE SWITCH (OPTIONAL)
- ELECTRIC TANK DRAIN (OPTIONAL)
- HOUR METER (OPTIONAL)
- TEST-OFF-AUTO SWITCH (OPTIONAL)

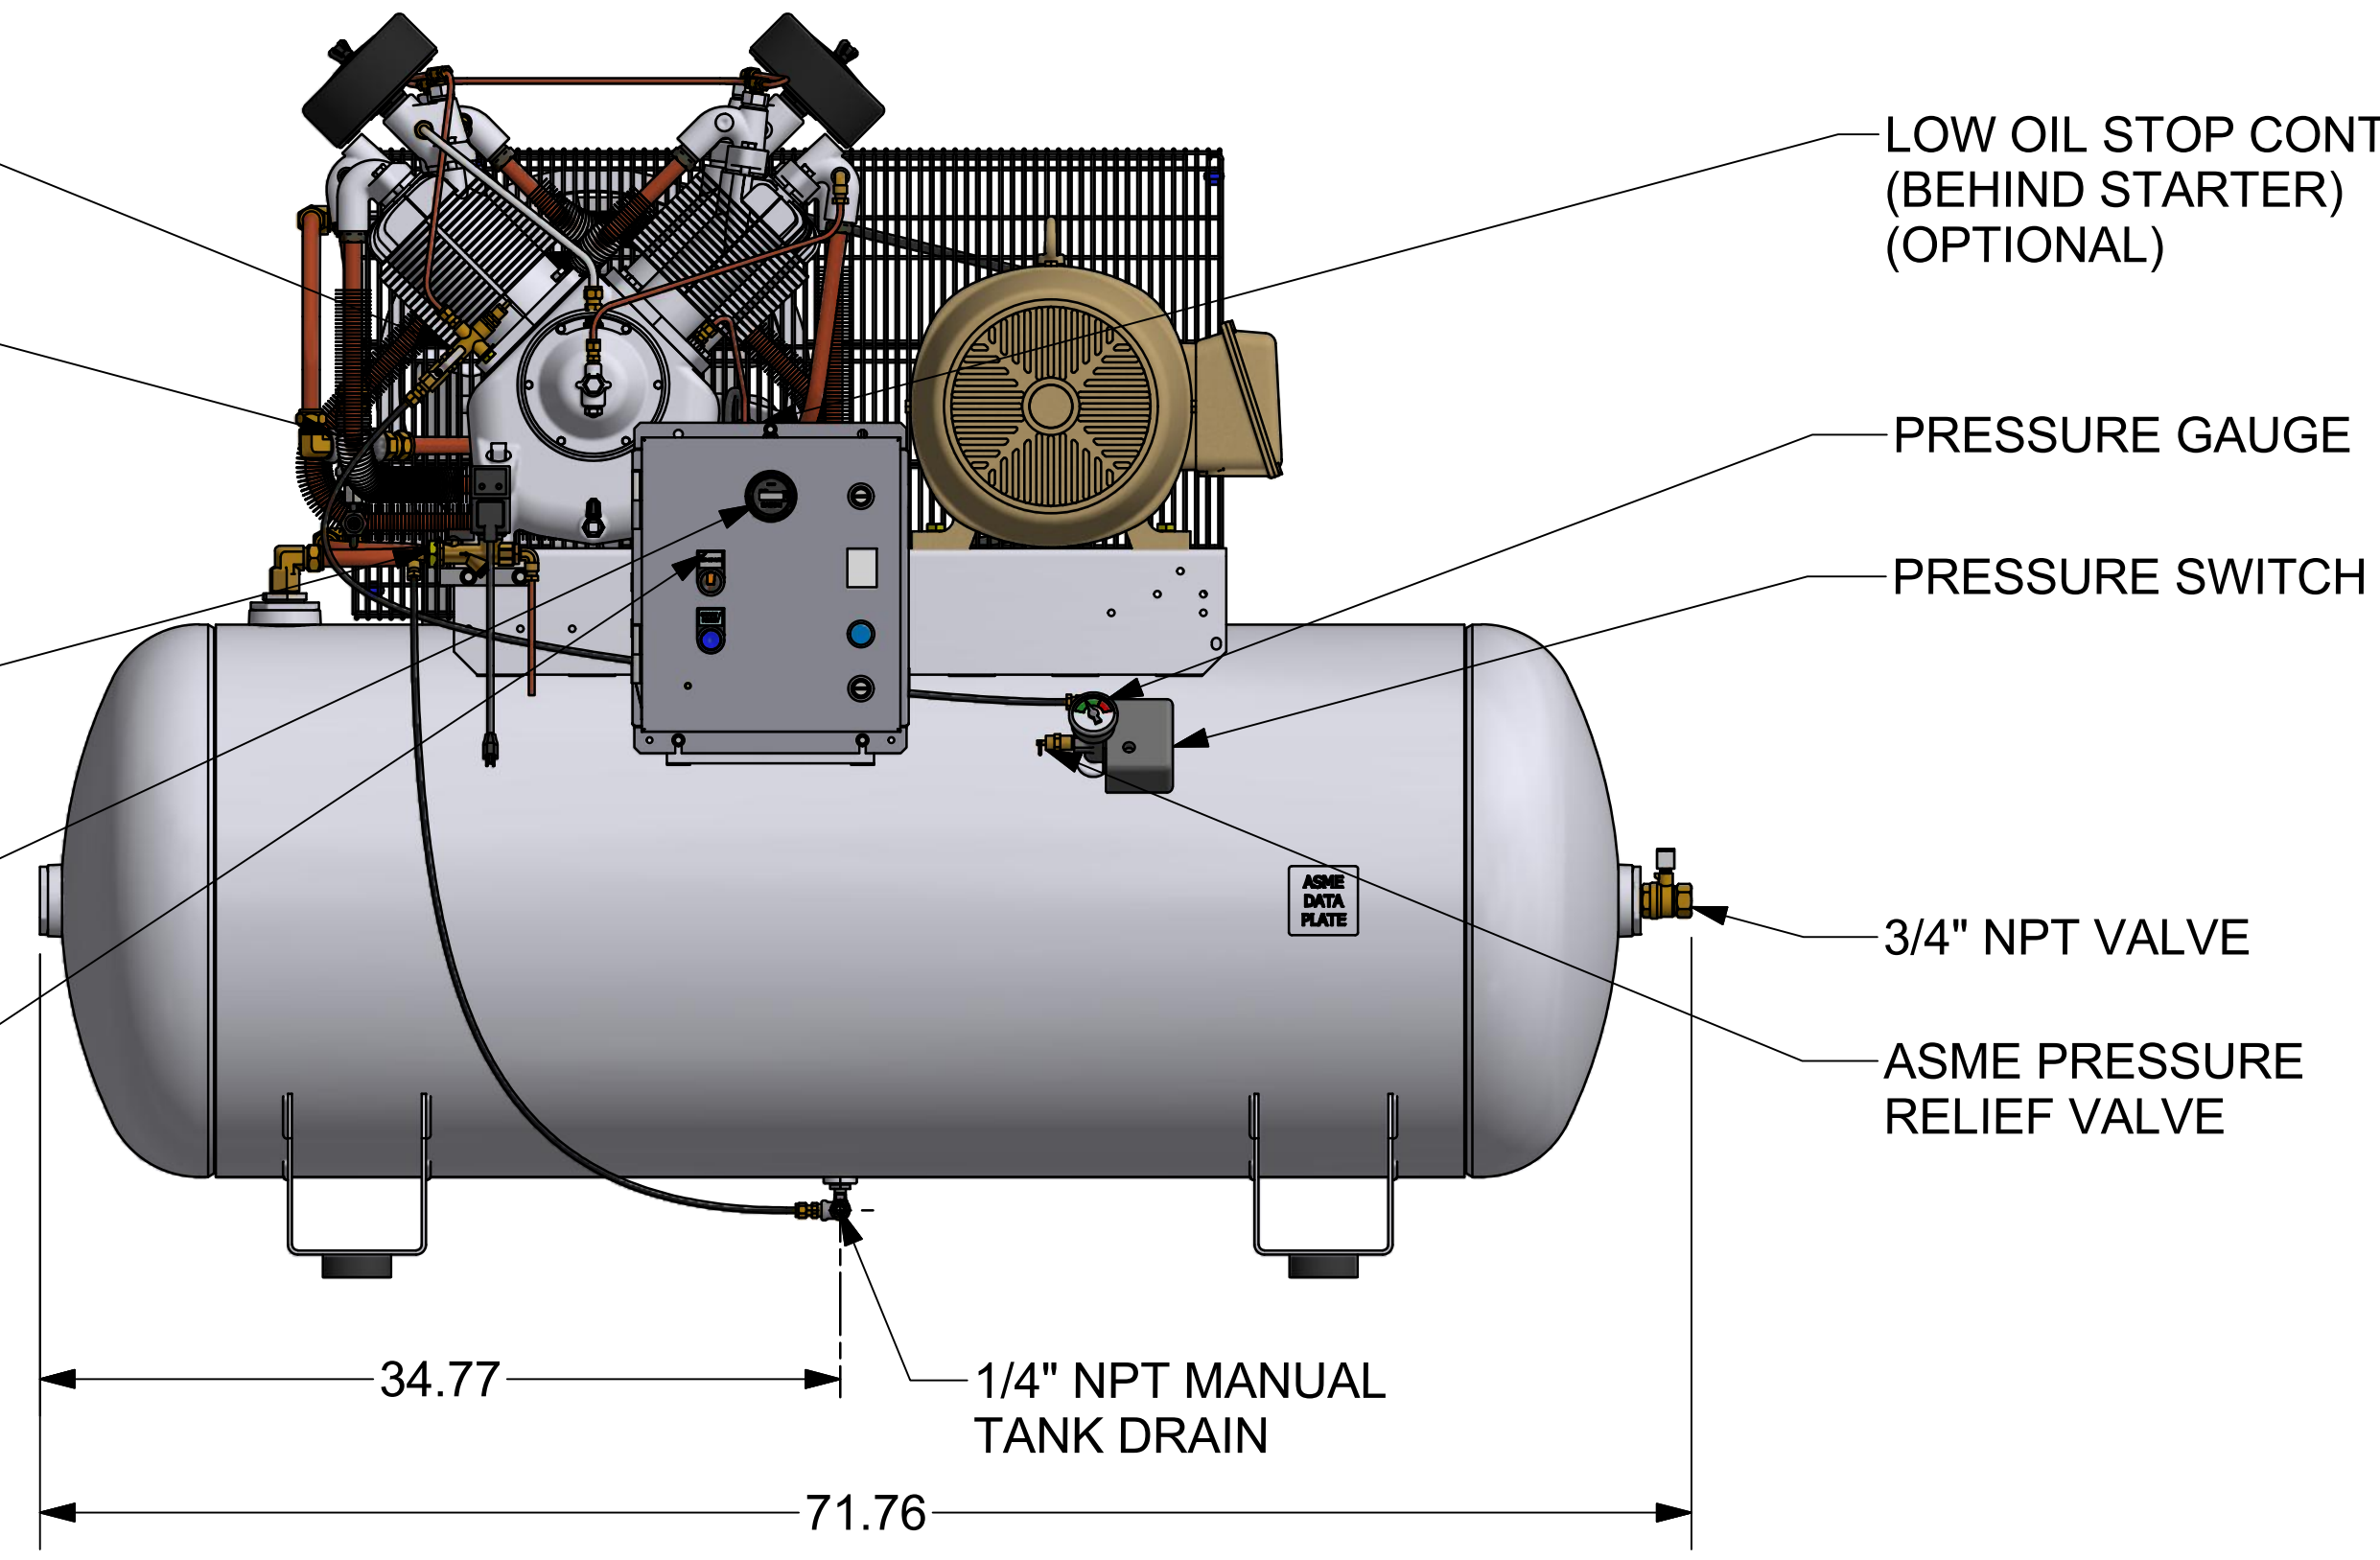

- LOW OIL STOP CONTROL (BEHIND STARTER) (OPTIONAL)
- PRESSURE GAUGE
- PRESSURE SWITCH
- 3/4" NPT VALVE
- ASME PRESSURE RELIEF VALVE
- 1/4" NPT MANUAL TANK DRAIN

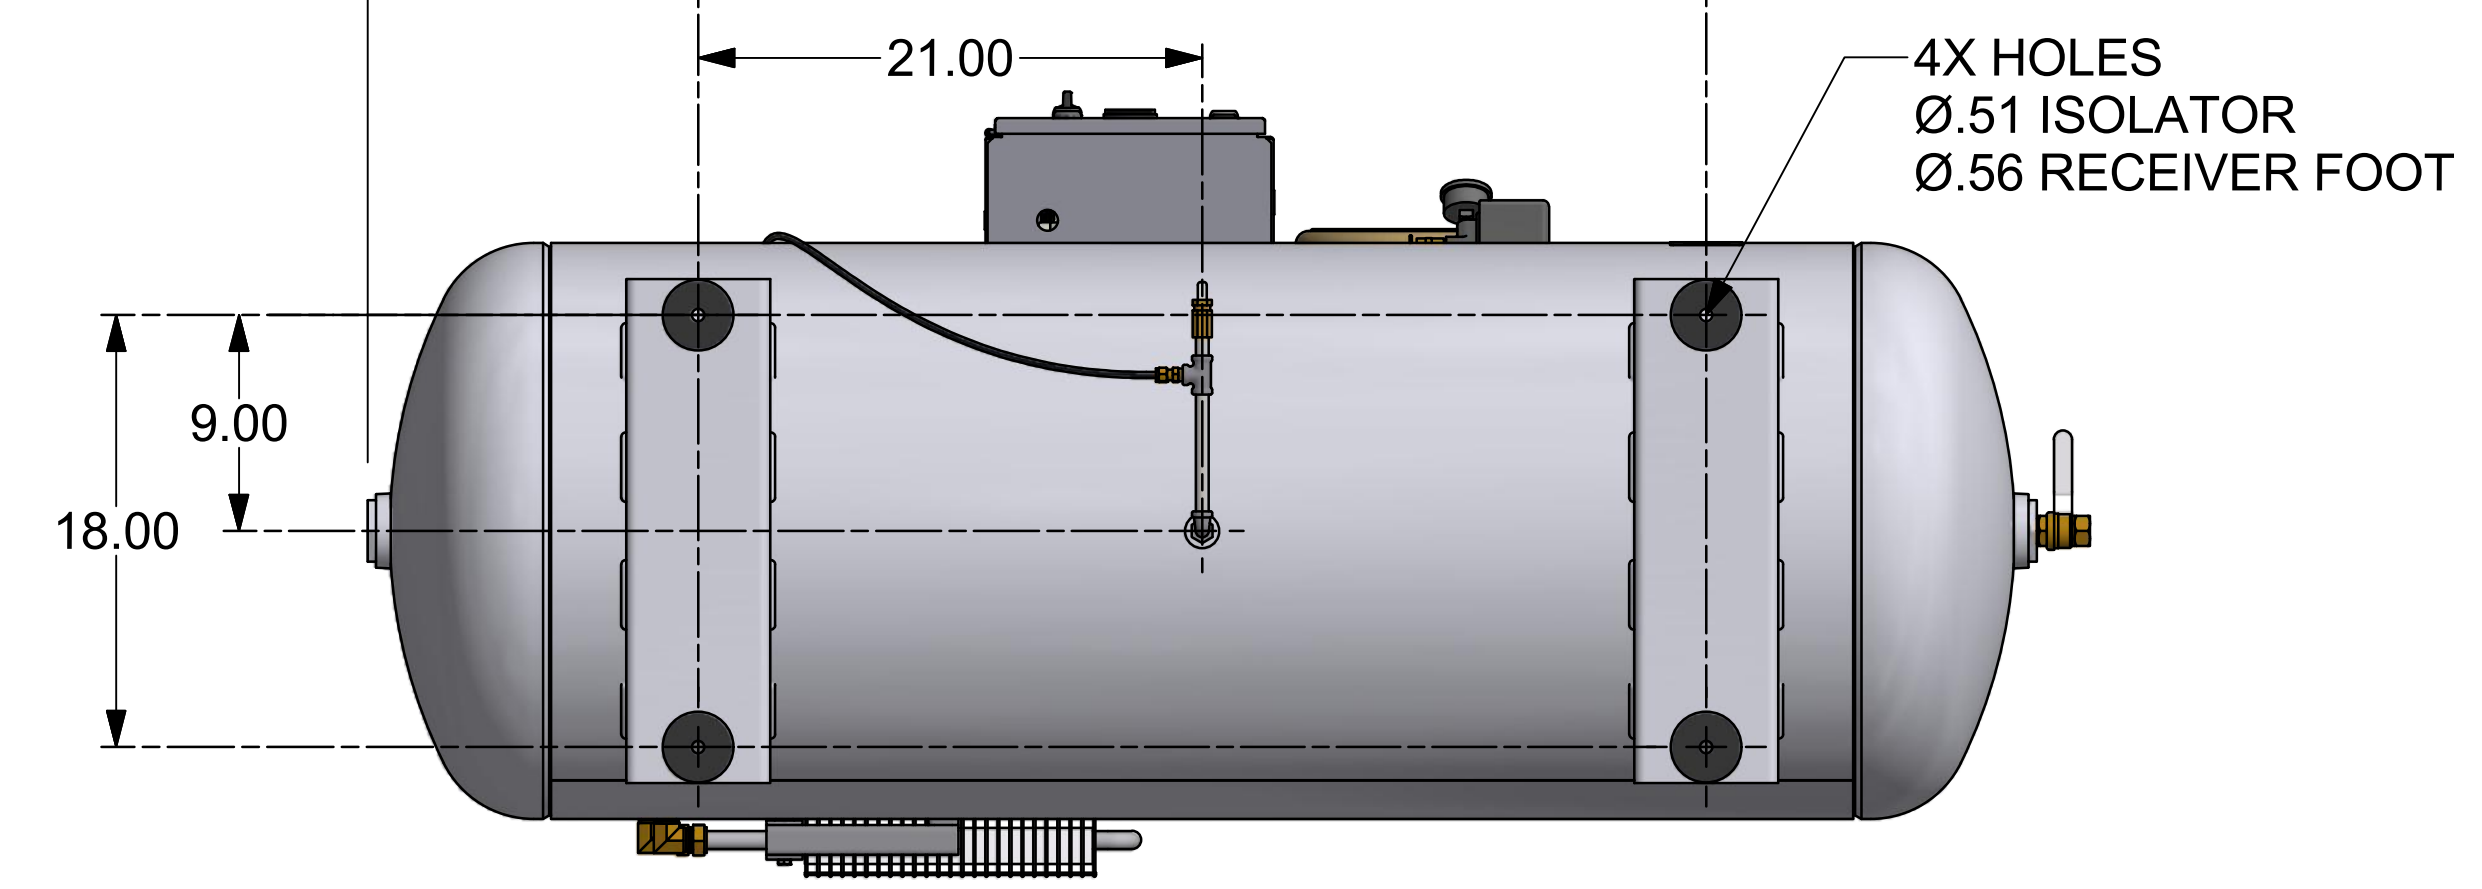

- 4X HOLES Ø.51 ISOLATOR Ø.56 RECEIVER FOOT

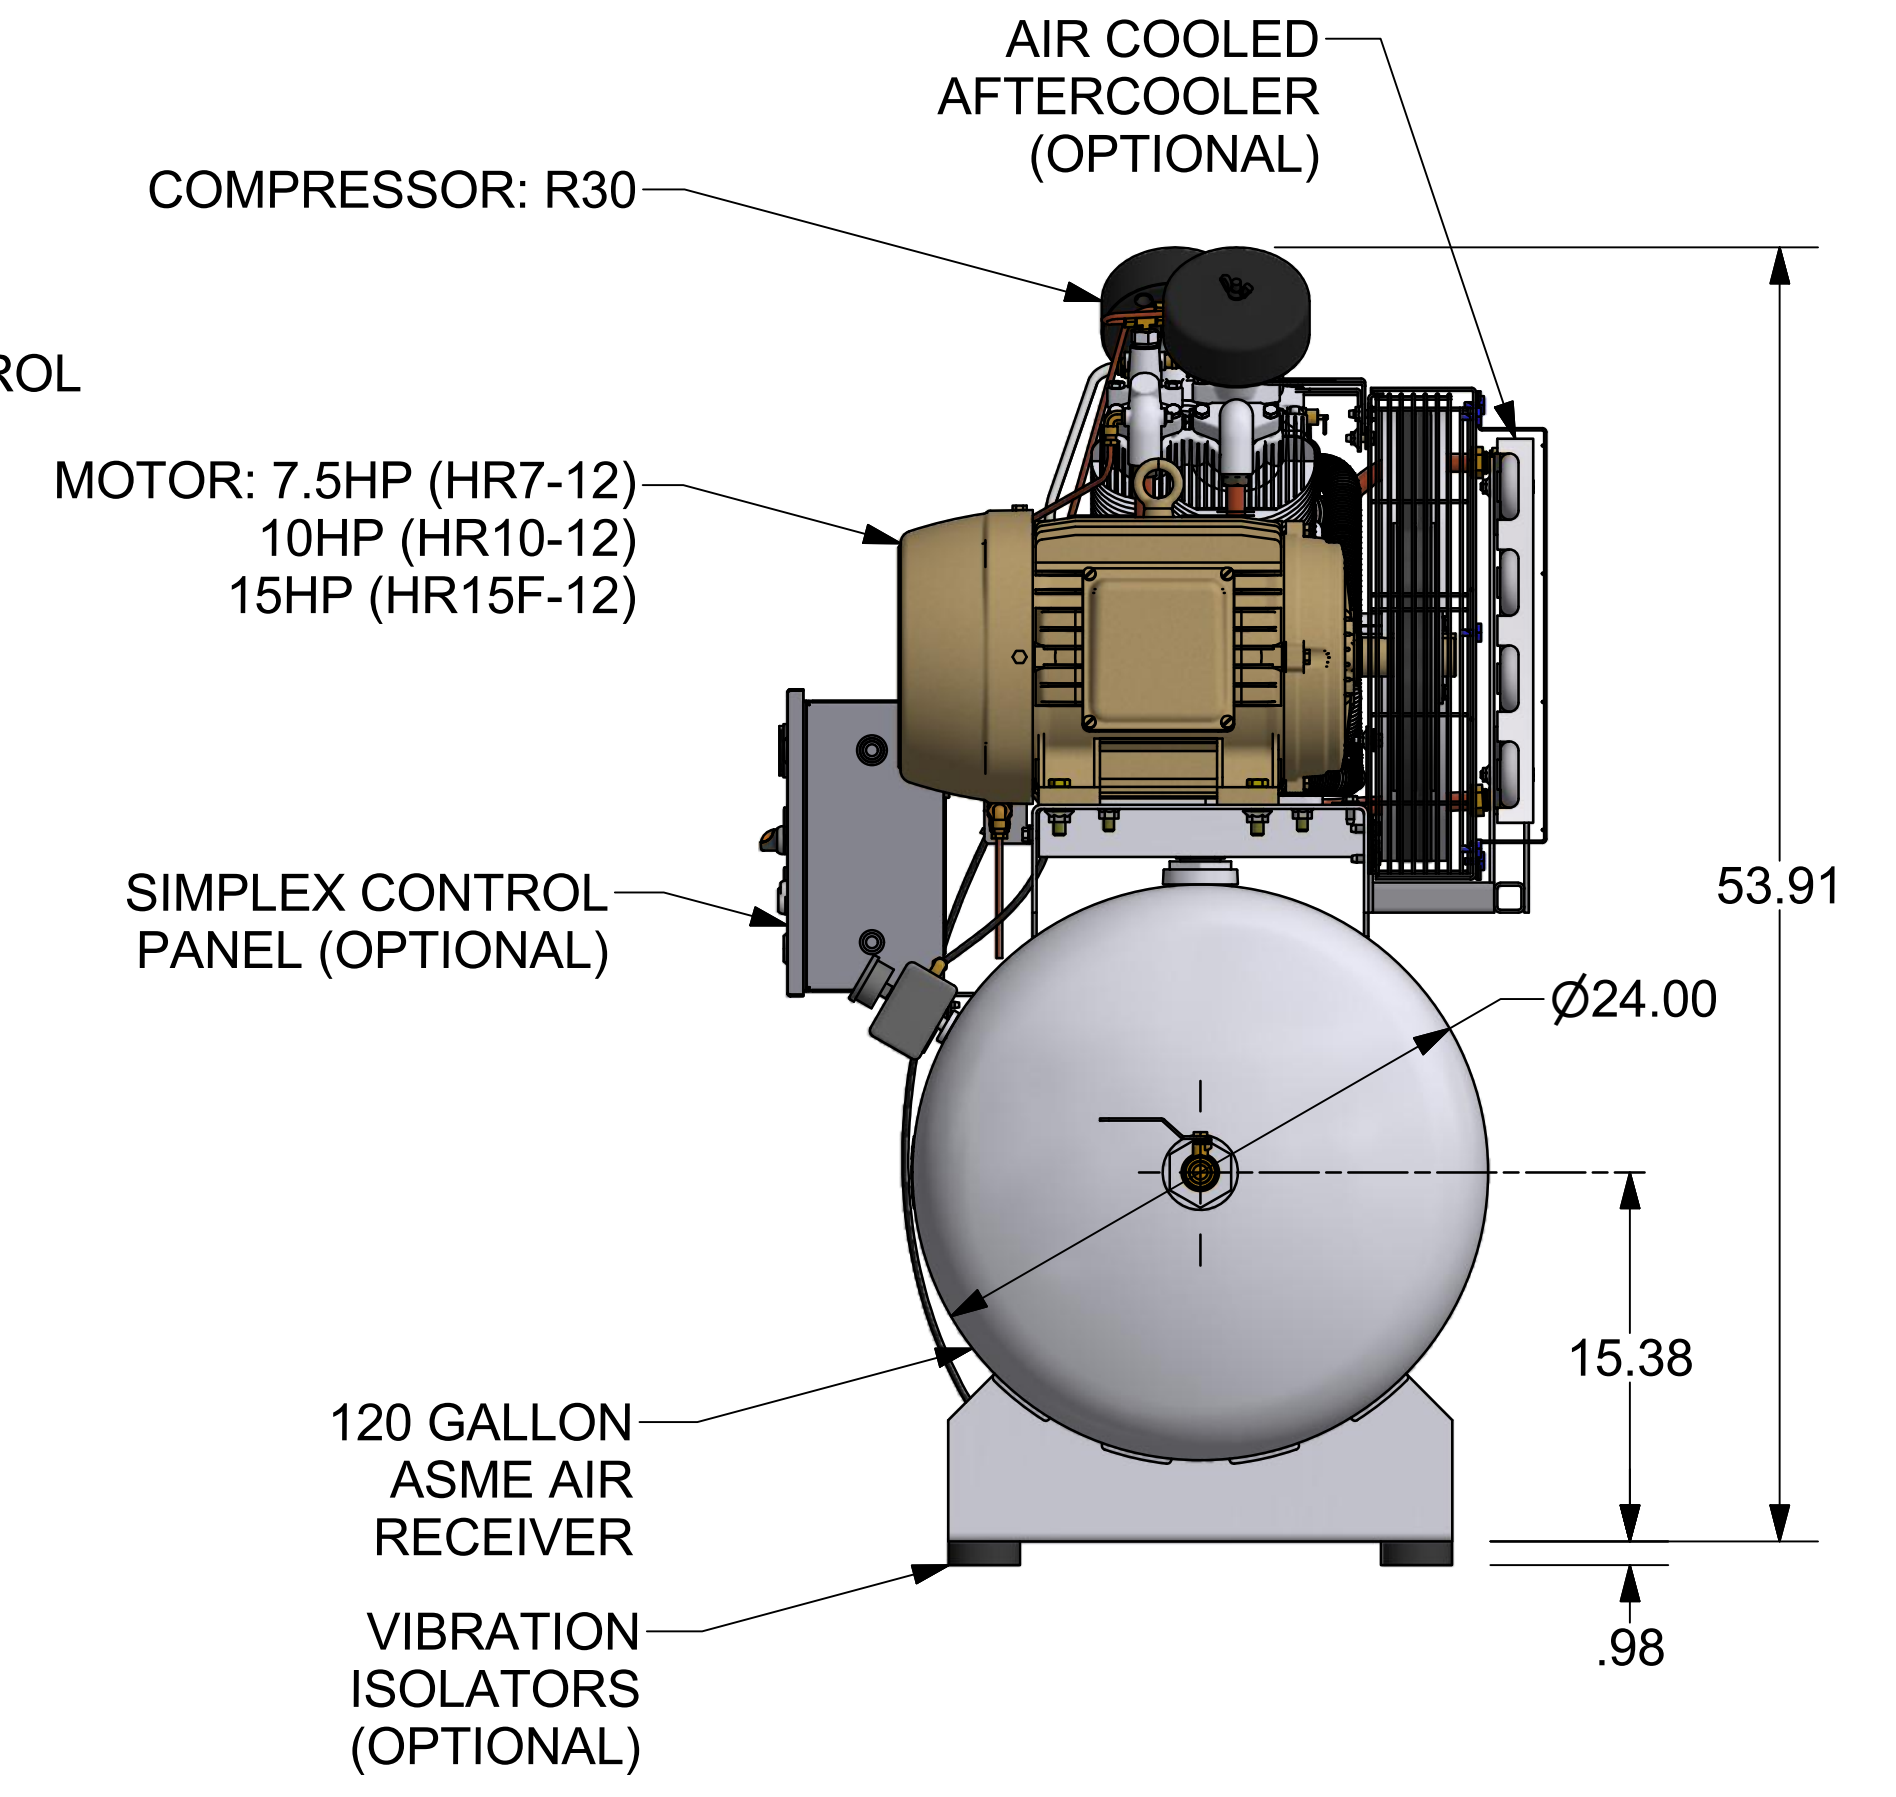

- AIR COOLED AFTERCOOLER (OPTIONAL)
- COMPRESSOR: R30
- MOTOR: 7.5HP (HR7-12) 10HP (HR10-12) 15HP (HR15F-12)
- SIMPLEX CONTROL PANEL (OPTIONAL)
- 120 GALLON ASME AIR RECEIVER
- VIBRATION ISOLATORS (OPTIONAL)

- NOTES:
- DO NOT SCALE DRAWING.
 - SPECIFICATIONS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE OR OBLIGATION.
 - ALL DIMENSIONS ARE IN INCHES.

FINISH OF CHAMFERS AND FILLETS TO CONFORM TO ROUGHEST ADJACENT AREA.		CONFIDENTIAL - THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE PROPERTY OF GARDNER DENVER, INC. IT IS NOT FOR PUBLIC DISCLOSURE. POSSESSION OF THE INFORMATION DOES NOT CONVEY ANY RIGHT TO LOAN, SELL OR DISCLOSE THE INFORMATION. UNAUTHORIZED REPRODUCTION OR USE OF THE INFORMATION IS PROHIBITED. THIS DOCUMENT IS TO BE RETURNED TO GARDNER DENVER, INC. UPON THE COMPLETION OF THE PURPOSE FOR WHICH IT IS LOANED OR UPON REQUEST.	
SURFACE ROUGHNESS MAXIMUM PER ASME B46.1. FULL THREAD DEPTHS ARE MINIMUM.		DIMENSIONING AND TOLERANCING PER ASME Y14.5-2009. THREADS PER ASME B1.1 GAGING SYSTEM 21 U.O.S., ANSI B1.20.1 & B1.20.3	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		HEAT TREATMENT: 327CAS800	
TOL. ON DECIMALS: .X = ± .05 TOL. ON DECIMALS: .XX = ± .02 TOL. ON DECIMALS: .XXX = ± AS SPECIFIED TOL. ON ANGLES: = ± 0°-30'		Gardner Denver Gardner Denver Inc. Quincy, IL.	
THIRD ANGLE PROJECTION		DESCRIPTION: 0800-OUTLINE-BARE UNIT OUTLINE-BARE, 120GL ELECTRIC HR7-12, HR10-12, HR15F-12	
DRAWN BY: kas1112 CHECKED BY: mrf0717		DATE: 29-Sep-17 SCALE: 14-Feb-18	
		REV: 02 SHEET: 1 OF 1	