

Heatless Modular Desiccant Air Dryers

HSHD SERIES 7 to 40 scfm (12 to 68 nm³/h)



Optimal System Protection

Hankison's HSHD Series Modular Desiccant Air Dryers protect moisture sensitive applications requiring low pressure dew points. Delivers dew points of ISO 8573-1: 2010 Class 1 (-94°F, -70°C) and Class 2 (-40°F, -40°C) with flow rates of 7 to 40 scfm (12 to 68 nm³/h). Critical applications include labs, hospitals, pharmaceutical manufacturing and other high-tech installations.

The HSHD Series incorporate a time proven design, with superior features and reliability, in a compact and easy to install package. Standard features include:

NGF SERIES FILTER PACKAGES STANDARD

- Grade HF coalescing prefilter captures oil down to 0.008 mg/m³
- Grade PF afterfilter removes solids 1.0 micron and larger

TECHNOLOGY AT A GLANCE


- Consistent outlet pressure dew points
- Selectable pressure dew point performance for maximum application flexibility
- Minimum purge air usage saves energy
- Desiccant beds sized to prevent fluidization plus slow and complete regeneration prevents desiccant aging
- Non-lubricated, soft seated control valves promotes reliable operation
- Heavy duty purge exhaust muffler for quiet operation

HIGHLY ACCURATE SOLID STATE TIMER

- Standard 4 minute cycle time delivers ISO Quality Class 2 pressure dew point
- Flow deration delivers ISO Quality Class 1 pressure dew point

EXTENDED WARRANTY

- One-year warranty standard
- Up to five-year warranty with purchase of annual maintenance kit

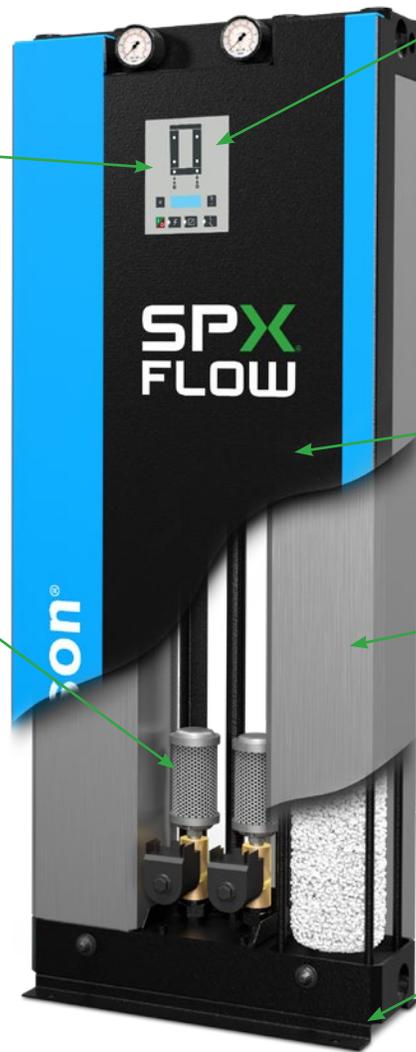

FRONT MOUNTED CONTROL PANEL

- Electronic controls to monitor status & operation
- Power on light
- Tower indicator lights
- On-off switch

SUPREME CRAFTSMANSHIP

- Powder coated cabinet for long term durability
- Fully assembled, piped and wired eases installation
- Extruded aluminum columns to house desiccant cartridges
- Supplied with 6' (1.8 m) power cord
- Flexible installation with multiple inlet/outlet options
- Floor mount support for secure installation

Product Specifications

MODEL	DIMENSIONS						IN/OUT CONNECTIONS	WEIGHT	
	H		W		D			lbs	kg
	in	mm	in	mm	in	mm	NPT		
HSHD-7	19	494	14	346	7	168	1/2"	77	35
HSHD-13	26	666	14	346	7	168	1/2"	93	42
HSHD-18	35	884	14	346	7	168	1/2"	112	51
HSHD-21	43	1101	14	346	7	168	1/2"	132	60
HSHD-27	39	994	15	383	7	189	1/2"	154	70
HSHD-40	49	1244	15	383	7	189	1/2"	181	82

Dryers are certified for quality and safety to CSA C22.2 No.0-10, C22.2 No.14-18 & UL 508.

Dew Point Performance

ISO CLASS 2		ISO CLASS 1	
Pressure Dew Point	Cycle Time	Pressure Dew Point	Cycle Time
-40°F (-40°C)	8 minutes: 4 minutes drying 4 minutes regenerating	-94°F (-70°C)	4 minutes: 2 minutes drying 2 minutes regenerating


HSHD series dryers operate automatically in producing a dehydrated gas stream

- User selectable ISO 8573.1 : 2010 Compressed Air Quality Class 2 (-40°F, -40°C) and (-94°F, -70°C) Class 1 pressure dew point
- At ISO 7183 (A2) conditions: Remaining water content at Class 1 pressure dew point: 0.002%
- At ISO 7183 (A2) conditions: Remaining water content at Class 2 pressure dew point: 0.2%
- ISO Class 1 requires 86°F (30°C) inlet air temperature

How It Works

Compressed air enters the dryer and is directed to Tower 1 by valve (A) to be dried, and then to the dryer outlet through shuttle valve (B). A portion of the dried air is throttled to near atmospheric pressure by means of orifice (C). This extremely dry, low pressure air flows through and regenerates the desiccant in Tower 2 and is exhausted through purge/repressurization valve (D) and exhaust muffler (E) to atmosphere. After a set time, the automatic solid state timer closes purge/repressurization valve (D) allowing Tower 2 to repressurize slowly. At the end of 2 minutes, valve (A) shifts and purge/repressurization valve (D) reopens.

The main air flow is now dried by Tower 2 while Tower 1 is being regenerated.

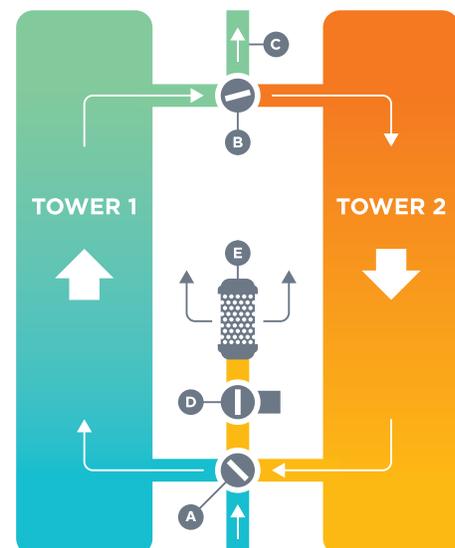

HSHD Series

7 to 40 scfm
12 to 68 nm³/h



TABLE 1 - INLET & PURGE FLOWS @ 100 PSIG

MODEL	INLET FLOW RATING ¹ SCFM (NM ³ /H)				PURGE FLOW ² SCFM (NM ³ /H)			
	-40°F	(-40°C)	-94°F	(-70°C)	Average		Maximum	
HSHD-7	7	12	5	8	1.5	2.3	1.8	2.7
HSHD-13	13	22	9	15	2.7	4.5	3.7	5.1
HSHD-18	18	31	12	20	3.7	5.7	4.4	6.5
HSHD-21	21	36	14	23.5	4.6	7.2	5.4	8.1
HSHD-27	27	46	18	30.5	5.3	8.3	6.2	9.2
HSHD-40	40	68	27	45.5	9.7	15	11.6	16.1

TABLE 2 - INLET & PURGE FLOW CORRECTION FACTORS

INLET PRESSURE	psig							
	50	70	90	100	110	120	130	150
	kg/cm ²							
	3.5	4.9	6.3	7	7.7	8.4	9.1	10.5
MULTIPLIER A	0.31	0.54	0.83	1.00	1.09	1.17	1.26	1.44
MULTIPLIER B	0.55	0.73	0.91	1.00	1.09	1.17	1.26	1.44

1 Inlet flows are established in accordance with CAGI (Compressed Air and Gas Institute) standard ADF-200, Dual Stage Regenerative Desiccant Compressed Air Dryers - Methods for Testing and Rating. Conditions for rating dryers are: inlet pressure - 100 psig (7 kg/cm²); inlet temperature - saturated at 100°F (38°C).

2 Average Purge Flow is the total amount of air used to purge and repressurize off-stream towers averaged over the cycle time. Maximum Purge Flow is the flow rate through the off-stream tower during that portion of the cycle the purge/repressurization valve is open.

CAPACITY CORRECTION FACTORS

- To determine maximum inlet flow at inlet pressures other than 100 psig (7 kg/cm²), multiply inlet flow from Table 1 by multiplier A from Table 2 that corresponds to system pressure at inlet of dryer.
- To determine purge flow at inlet pressures other than 100 psig (7 kg/cm²), multiply purge flow at 100 psig (7 kg/cm²), from Table 1 by multiplier B from Table 2 that corresponds to system pressure at inlet of dryer.
- To determine outlet flow capacity, subtract purge flow from inlet flow.

SPX FLOW INC.

4647 SW 40th Avenue
Ocala, Florida 34474-5788 U.S.A.
P: (724) 745-1555
F: (724) 745-6040
E: hankison.americas@spxflow.com
www.spxflow.com/hankison

SPX FLOW, Inc. reserves the right to incorporate our latest design and material changes without notice or obligation.

Design features, materials of construction and dimensional data, as described in this bulletin, are provided for your information only and should not be relied upon unless confirmed in writing. Please contact your local sales representative for product availability in your region. For more information visit www.spxflow.com.

The green "S" and "X" are trademarks of SPX FLOW, Inc.